



District Level Water Testing Laboratory (Uttar Pradesh Jal Nigam, Pilibhit)

Address: Office of Executive Engineer, Construction Division,
U.P. Jal Nigam In front of district veterinary Hospital, Tanakpur road, Pilibhit. Pin- 262001



TC-9961

TEST REPORT

Rept. No	3902	Date:	13-08-2024
Customer Details			
Office Name and Address	Akal Academy Kajri, Kajri Niranjapur, Puranpur, Pilibhit		
Ref Letter No & Date	Application by customer 08-08-2024		
Sample Discription			
District	Pilibhit	Block	Puranpur
Gram Panchayat/Nagar Panchayat	Kajri Niranjapur	Village/Ward No.	Kajri Niranjapur
Habitation	Kajri Niranjapur	Location	Akal Academy Kajri
Water Source	Submersible	Sample Code	PIL824/08/3902
Date & Time of Sample Collection	12-08-2024 09:10AM	Sample Collector Name	Gurpreet Singh
Receiving Date & Time	12-08-2024 10:40AM	Sample Receiver	Sanjeev Kumar
Water Sample Type	Drinking Water	Quantity of Sample	1000 ml
Analysis Date	12-08-2024 to 13-08-2024		

Technical Data of Analysis

Sr. No	Analyzed parameters (Unit of Measurement)	Observed Value	Unit	Specified Values as per BIS		Ref. Method of Analysis
				Acceptable Limit	Permissible Limit	
1	Chloride	15.99	mg/l	250	1000	IS 3025 (Part 32) : 2019
2	Fluoride	0.122	mg/l	1	1.5	APHA 24th Edition 4500-F ⁻ Method C (Electrode Method) : 2023
3	Iron	0.107	mg/l	1	No relaxation	IS 3025 (Part 53) : 2019
4	Nitrate	4.6	mg/l	45	No relaxation	APHA 24th Edition 4500-NO ₃ ⁻ Method B (UV Screening Method):2023
5	pH	7.51	NA	6.5-8.5	No relaxation	IS 3025 (Part 11) : 2022
6	Sulphate	9.3	mg/l	200	400	APHA 24th Edition 4500-SO ₄ ⁻² Method E (Tubidimetric Method) : 2023
7	TDS	221	mg/l	500	2000	IS 3025 (Part 16) : 2023
8	Total Alkalinity	145	mg/l	200	600	IS 3025 (Part 23) : 2023
9	Total Hardness	92	mg/l	200	600	IS 3025 (Part 21) : 2019
10	Turbidity	1.88	NTU	1	5	IS 3025 (Part 10) : 2023

11	Total Coliform*	0	CFU	No relaxation	-	APHA 23 rd Edition :2017 (IS 10500)
12	E .Coli*	0	CFU	No relaxation	-	APHA 23 rd Edition :2017 (IS 10500)


Note 1. This Certificate refers only to the particular sample(s) submitted for testing.

- This certificate shall not be reproduced, except in full, unless written permission for the publication of an approved abstract has.
- The test results reported in this certificate are valid at the time of and under the stated conditions of measurements.
- Sample will be stored up to 2-3 days (in case of non perishable items only) from the date of issue of tests reports unless.
- *indicates parameters that are not NABL accredited.

Authorized Signatory
Anuj Kumar
(Chemist)

Lab.Chemist
U.P. Jai Nigam
PILIBHIT

-----End of the Report-----

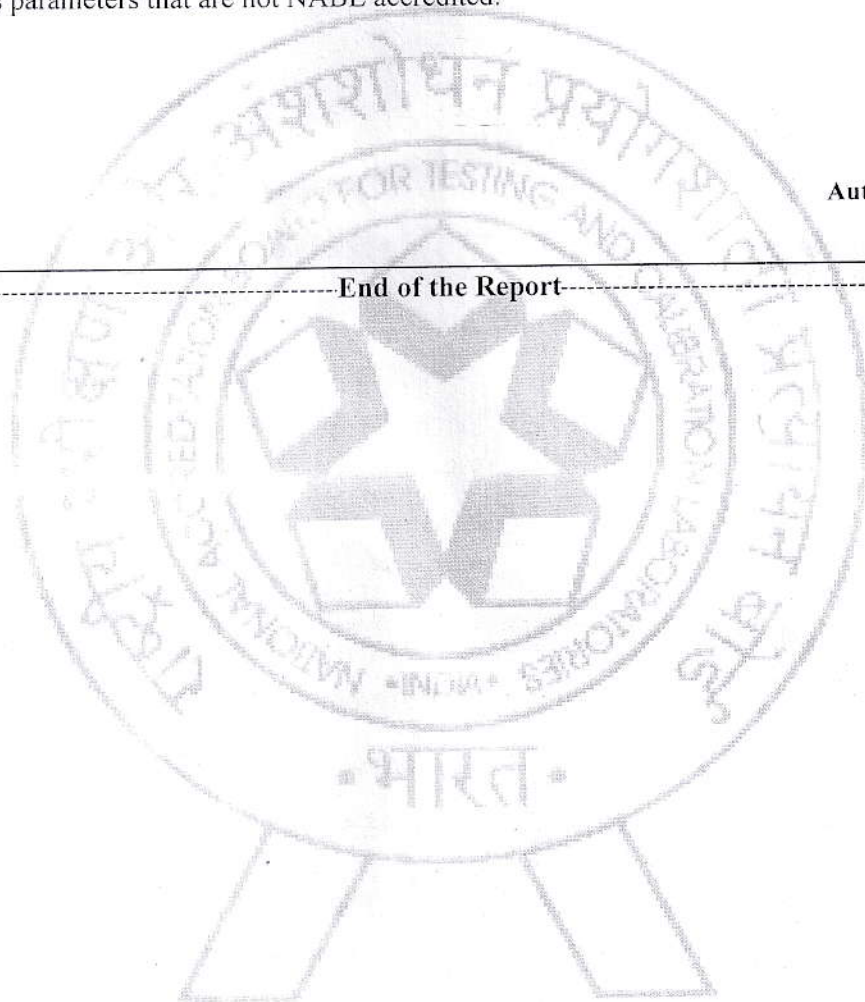

TC-9961

PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. PIL/24/08/3902Dated: 13/08/2024

It is certified that an inspection team headed by Anuj Kumar Lab. Chemist
 (Name of Officers with designation) from U.P. Jal Nigam (Rural)
 (Name of Department/ Office) inspected the Akal Academy Kajri Purnapur Pilibhit
 (Name & Address of the school) on 09/08/2024 (date of inspection) and found that the
Akal Academy Kajri Purnapur (Name of school) has safe drinking water
 facilities for the students and members of staff of the institution and is maintaining the hygienic
 sanitation condition in the school building & the campus as per norms prescribed by the Central/
 State/ U.T. Govt.

The above is valid for a period of 6 MonthSignature with Seal: U

Name

Manish Gangwar

Designation

Executive Engineer
Division Office
U.P. Jal Nigam (Rural)
Pilibhit

Name & Address of the Office / Department :

To

Akal Academy Kajrivill. - Kajri Niranjanpur Purnapur Pilibhit.

(Name & Address of the Institution)

* The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.